

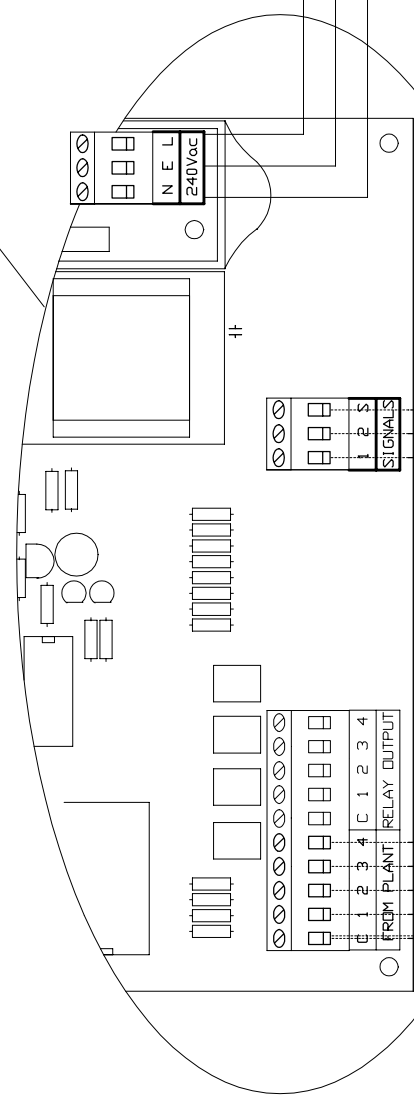
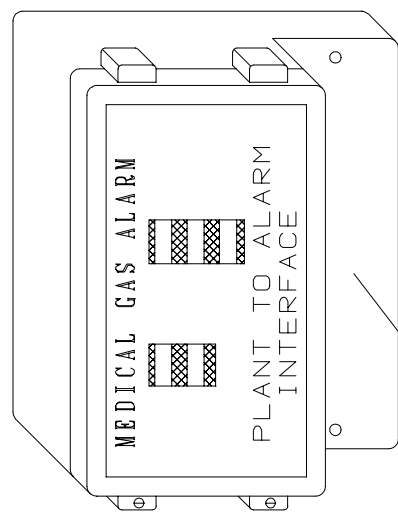


PLANT TO ALARM INTERFACE UNIT

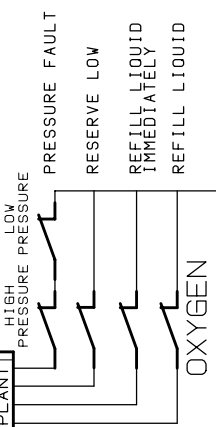

56K OHM RESISTORS
MUST BE FITTED TO
ANY UNUSED INPUTS

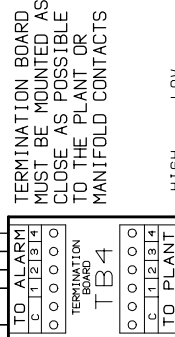

V. I. E. CONTACTS

NOTE

ALL SIGNAL CABLE TO BE A MINIMUM OF 0.5 mm sq SCREENED / S.W.A / OR IN METAL CONDUIT.
ALL JUNCTION BOXES MUST HAVE THE SCREENS CONNECTED THROUGH SCREENS MUST BE EARTHED