

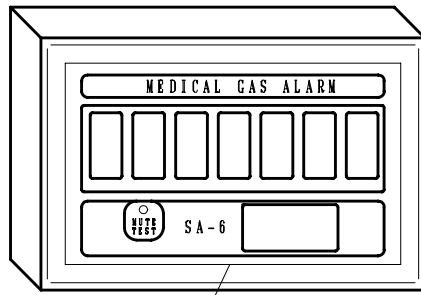


SA-6 AREA ALARM

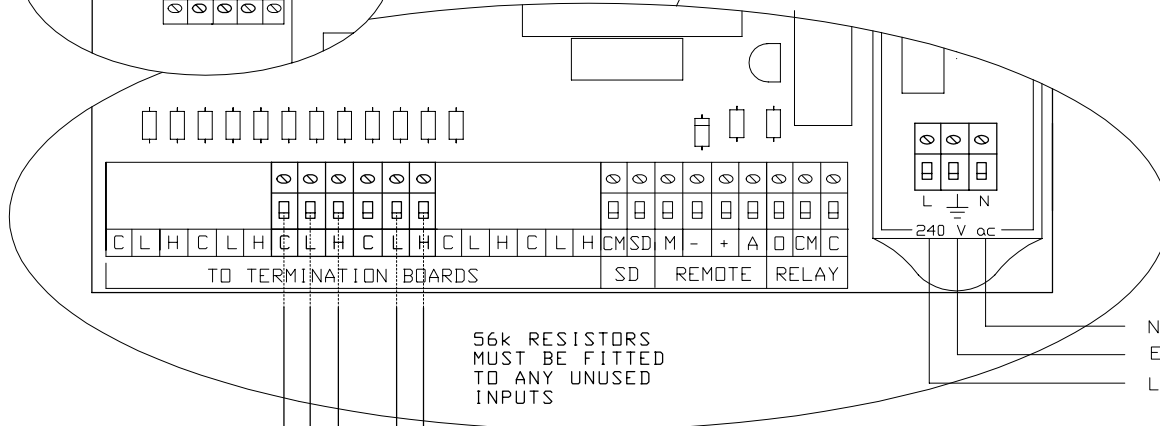


CHECK 'LINK'
'SO' to 'SM'

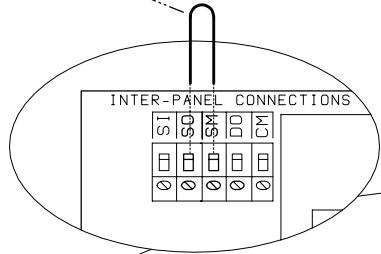

NEUTRAL
EARTH
LIVE

240 Vac SUPPLY
FUSED AT 3 AMPS

NOTE
TERMINATION BOARDS OR
BOXES MUST BE MOUNTED
AS CLOSE AS POSSIBLE
TO THE PRESSURE SWITCHES

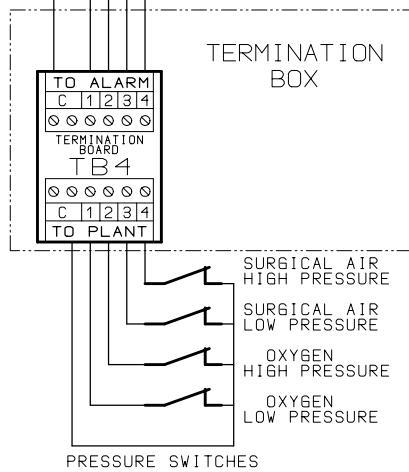

NOTE

ALL SIGNAL CABLE TO BE A MINIMUM
OF 0.5 mm sq SCREENED / S.W.A /
OR IN METAL CONDUIT.
ALL JUNCTION BOXES MUST HAVE
THE SCREENS CONNECTED THROUGH

Shire Controls Ltd

Title

SA-6 2 GAS AREA ALARM

Drawing No SA2G

Date 26-02-98

Issue 1