


CHECK 'LINK'  
'SO' to 'SM'

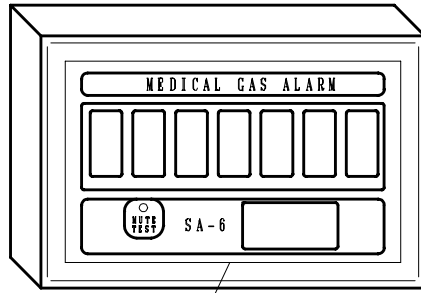

# SA-6 AREA ALARM


Shire Controls Ltd

Title

SA-6 5 GAS AREA ALARM

Drawing No SA5G


Date 29-03-99 Issue 1

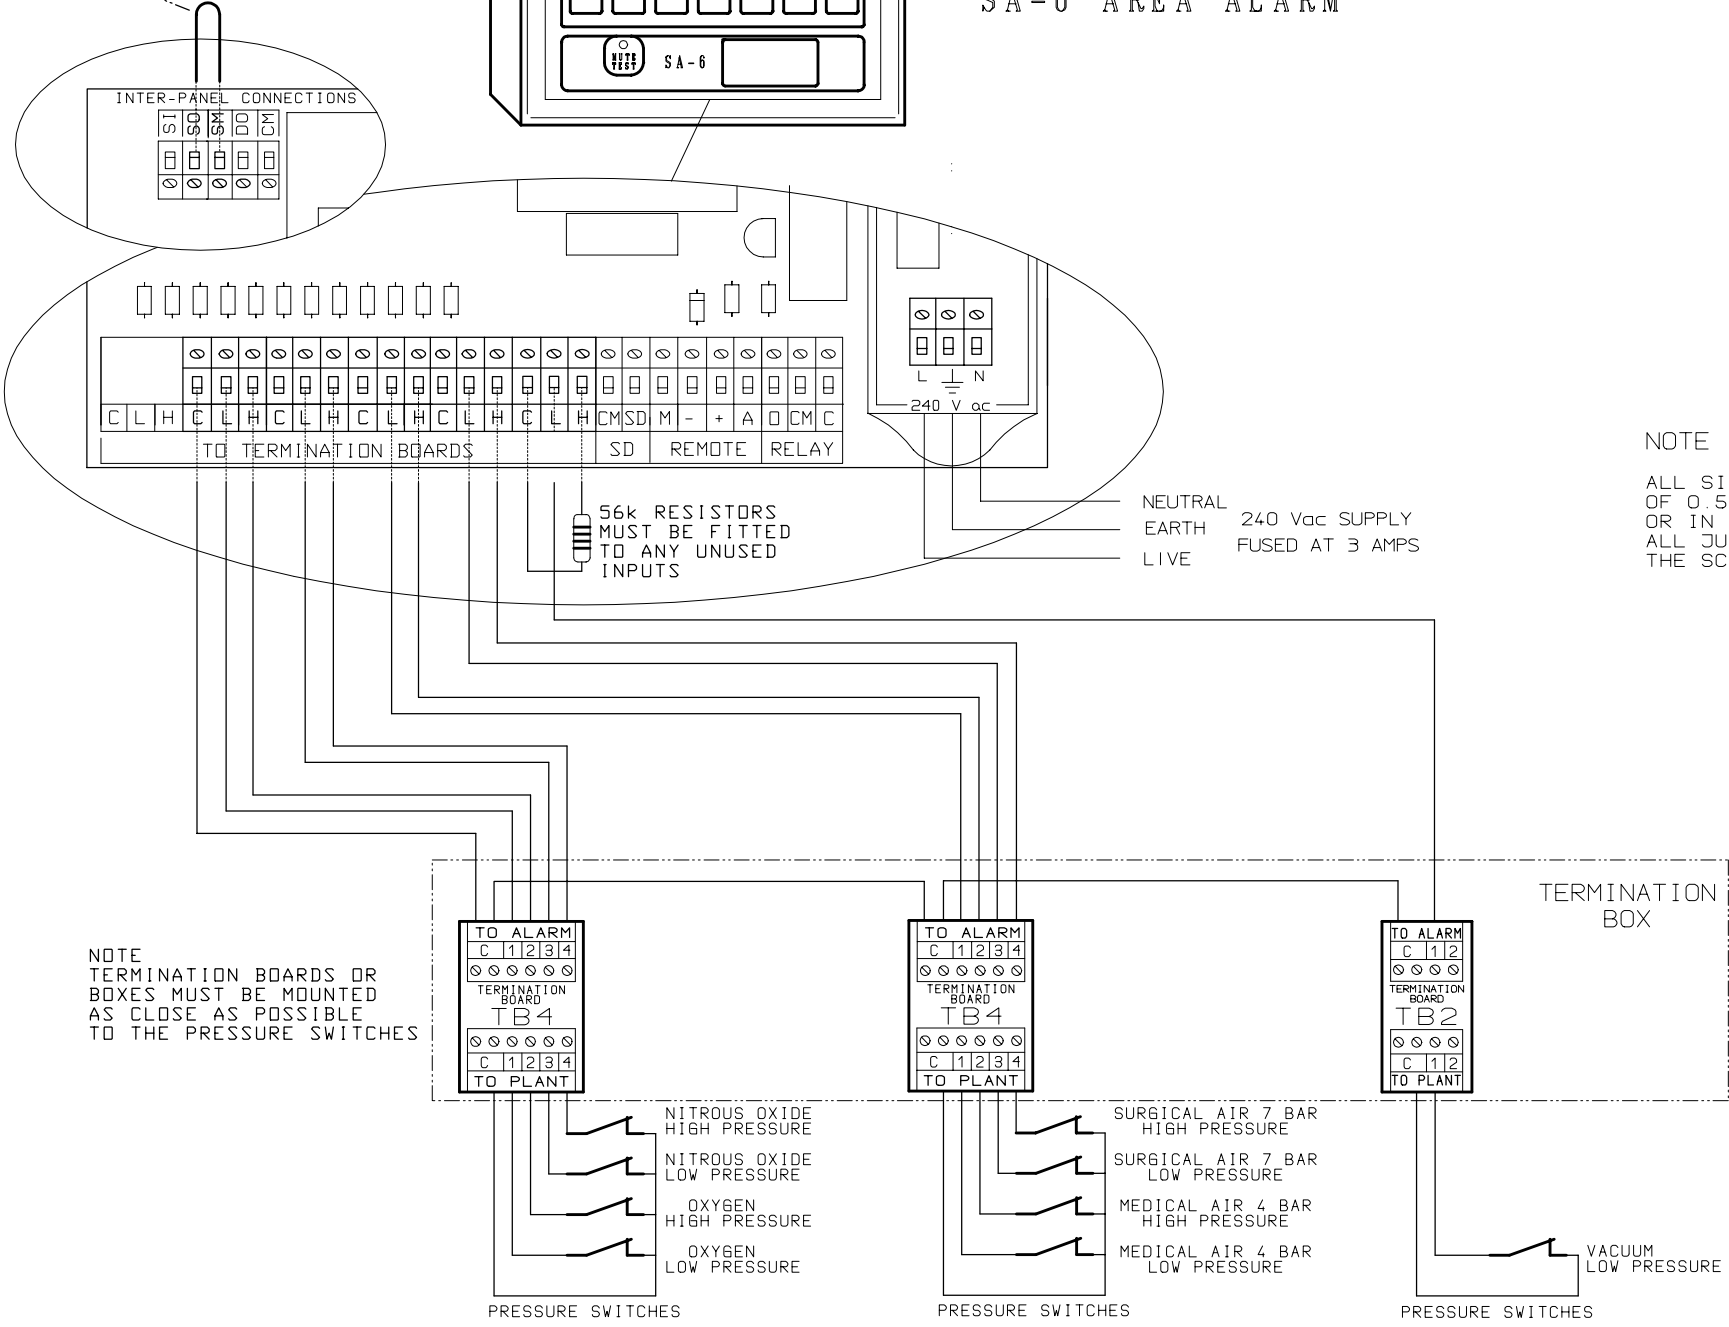

**NOTE**

ALL SIGNAL CABLE TO BE A MINIMUM OF 0.5 mm sq SCREENED / S.W.A / OR IN METAL CONDUIT. ALL JUNCTION BOXES MUST HAVE THE SCREENS CONNECTED THROUGH

NOTE  
TERMINATION BOARDS OR BOXES MUST BE MOUNTED AS CLOSE AS POSSIBLE TO THE PRESSURE SWITCHES

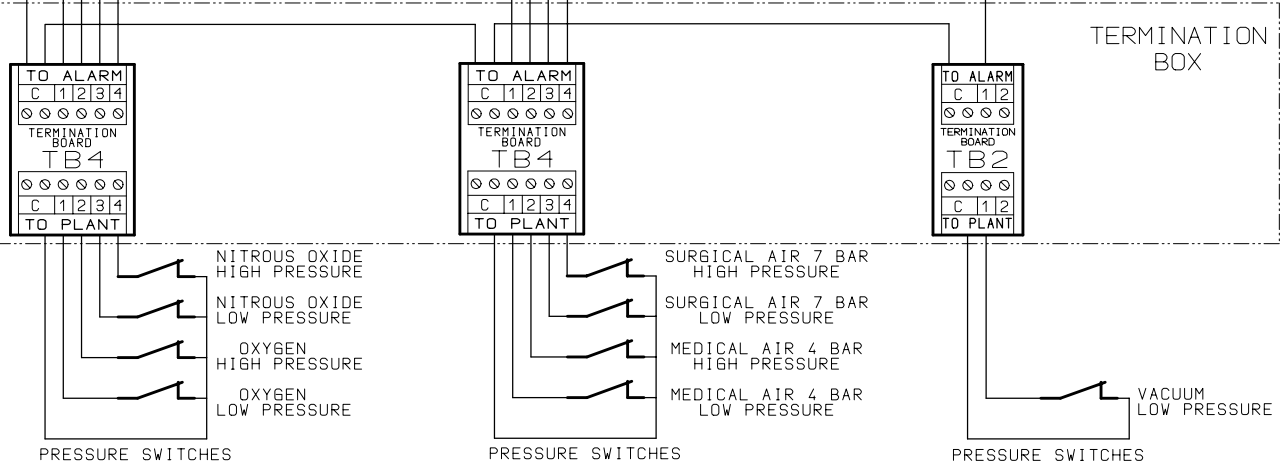

PRESSURE SWITCHES

PRESSURE SWITCHES

PRESSURE SWITCHES

TERMINATION BOX

