


CHECK 'LINK'
'SO' to 'SM'

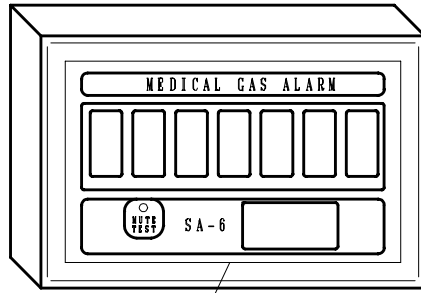

SA-6 AREA ALARM


Shire Controls Ltd

Title

SA-6 6 GAS AREA ALARM







Drawing No SA6G

Date 29-03-99 Issue 1

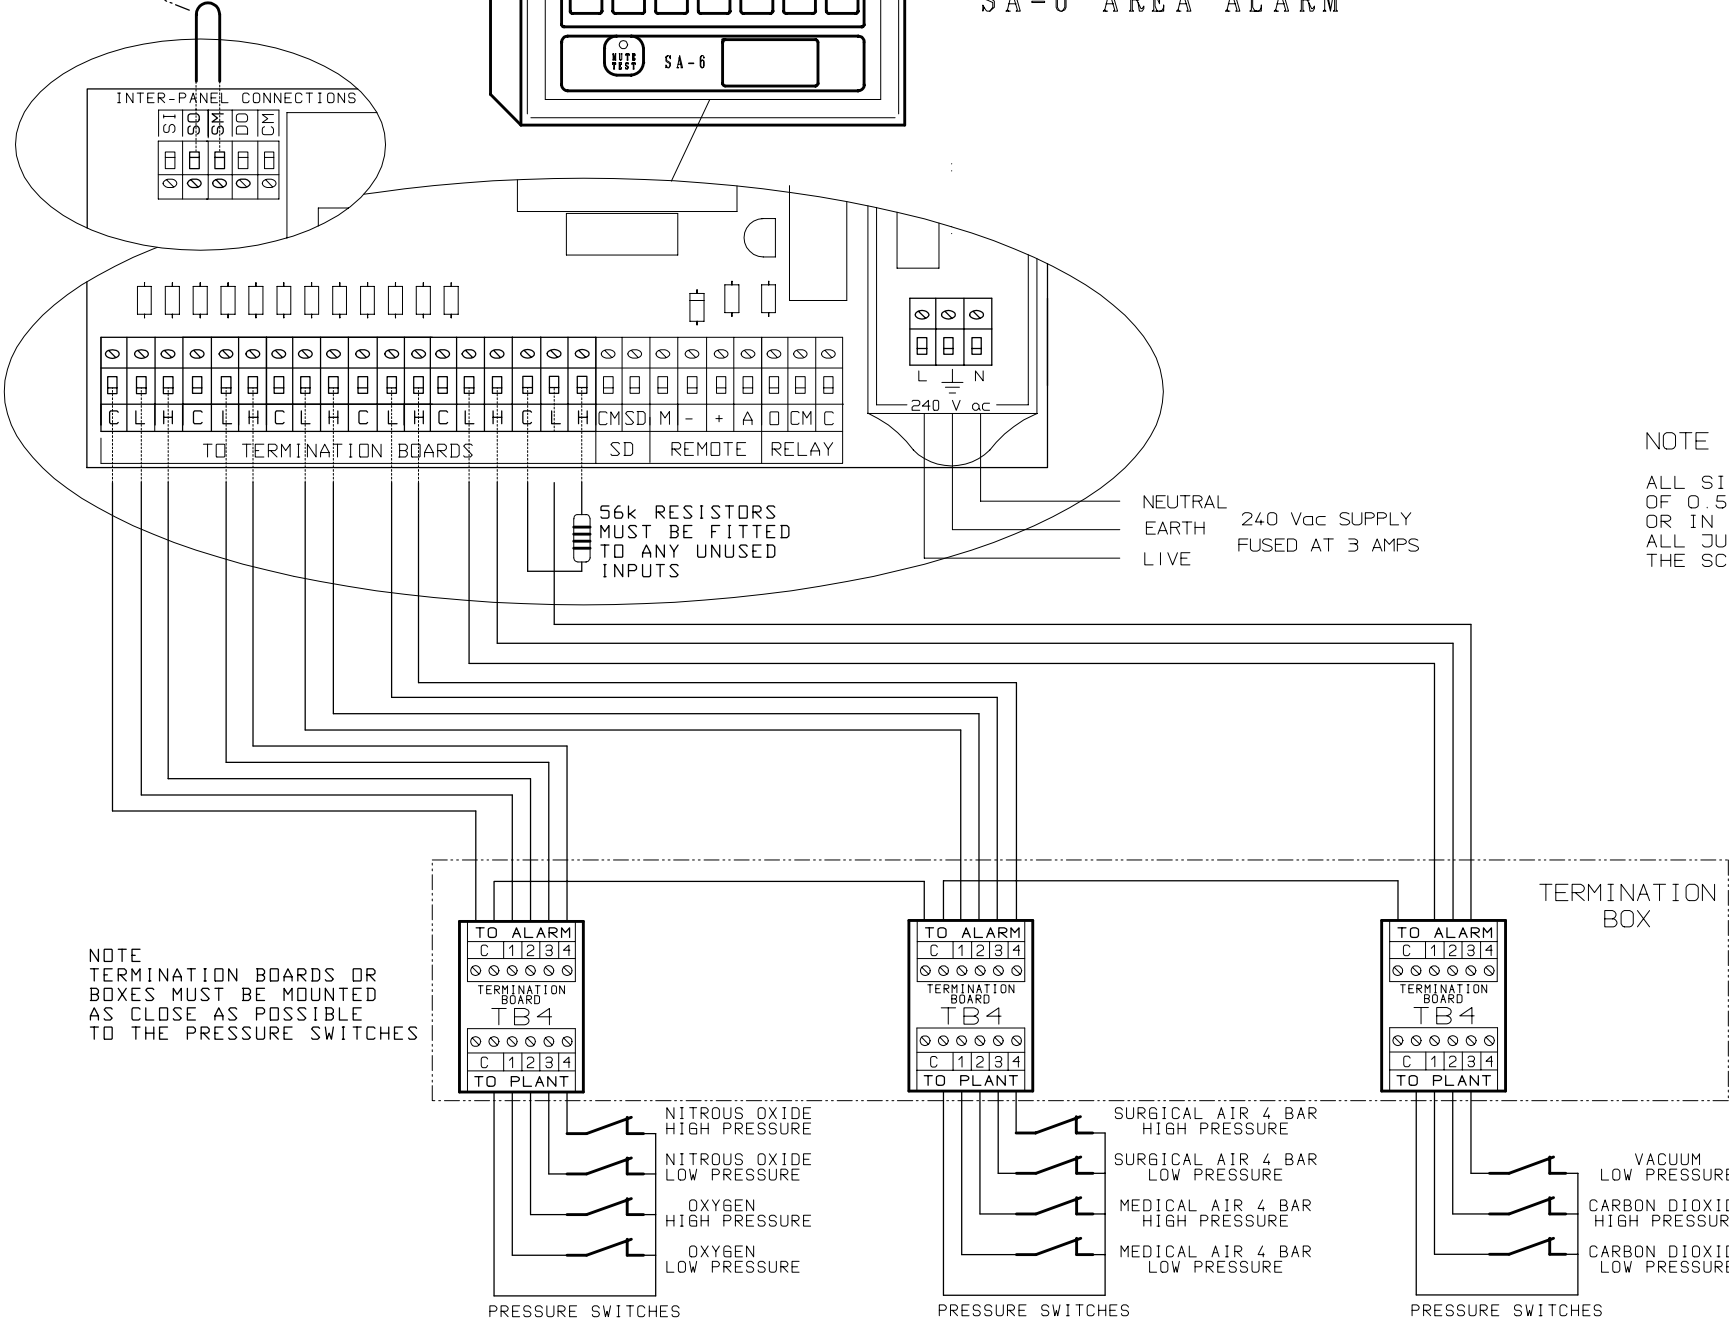

NOTE
TERMINATION BOARDS OR
BOXES MUST BE MOUNTED
AS CLOSE AS POSSIBLE
TO THE PRESSURE SWITCHES

NOTE
ALL SIGNAL CABLE TO BE A MINIMUM
OF 0.5 mm sq SCREENED / S.W.A /
OR IN METAL CONDUIT.
ALL JUNCTION BOXES MUST HAVE
THE SCREENS CONNECTED THROUGH

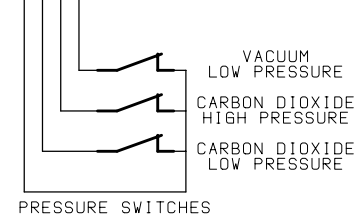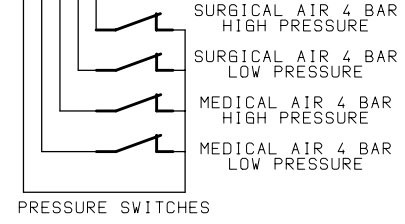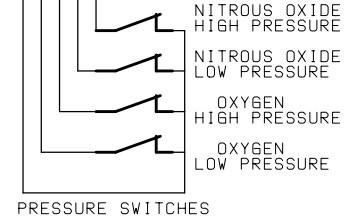

TERMINATION BOX