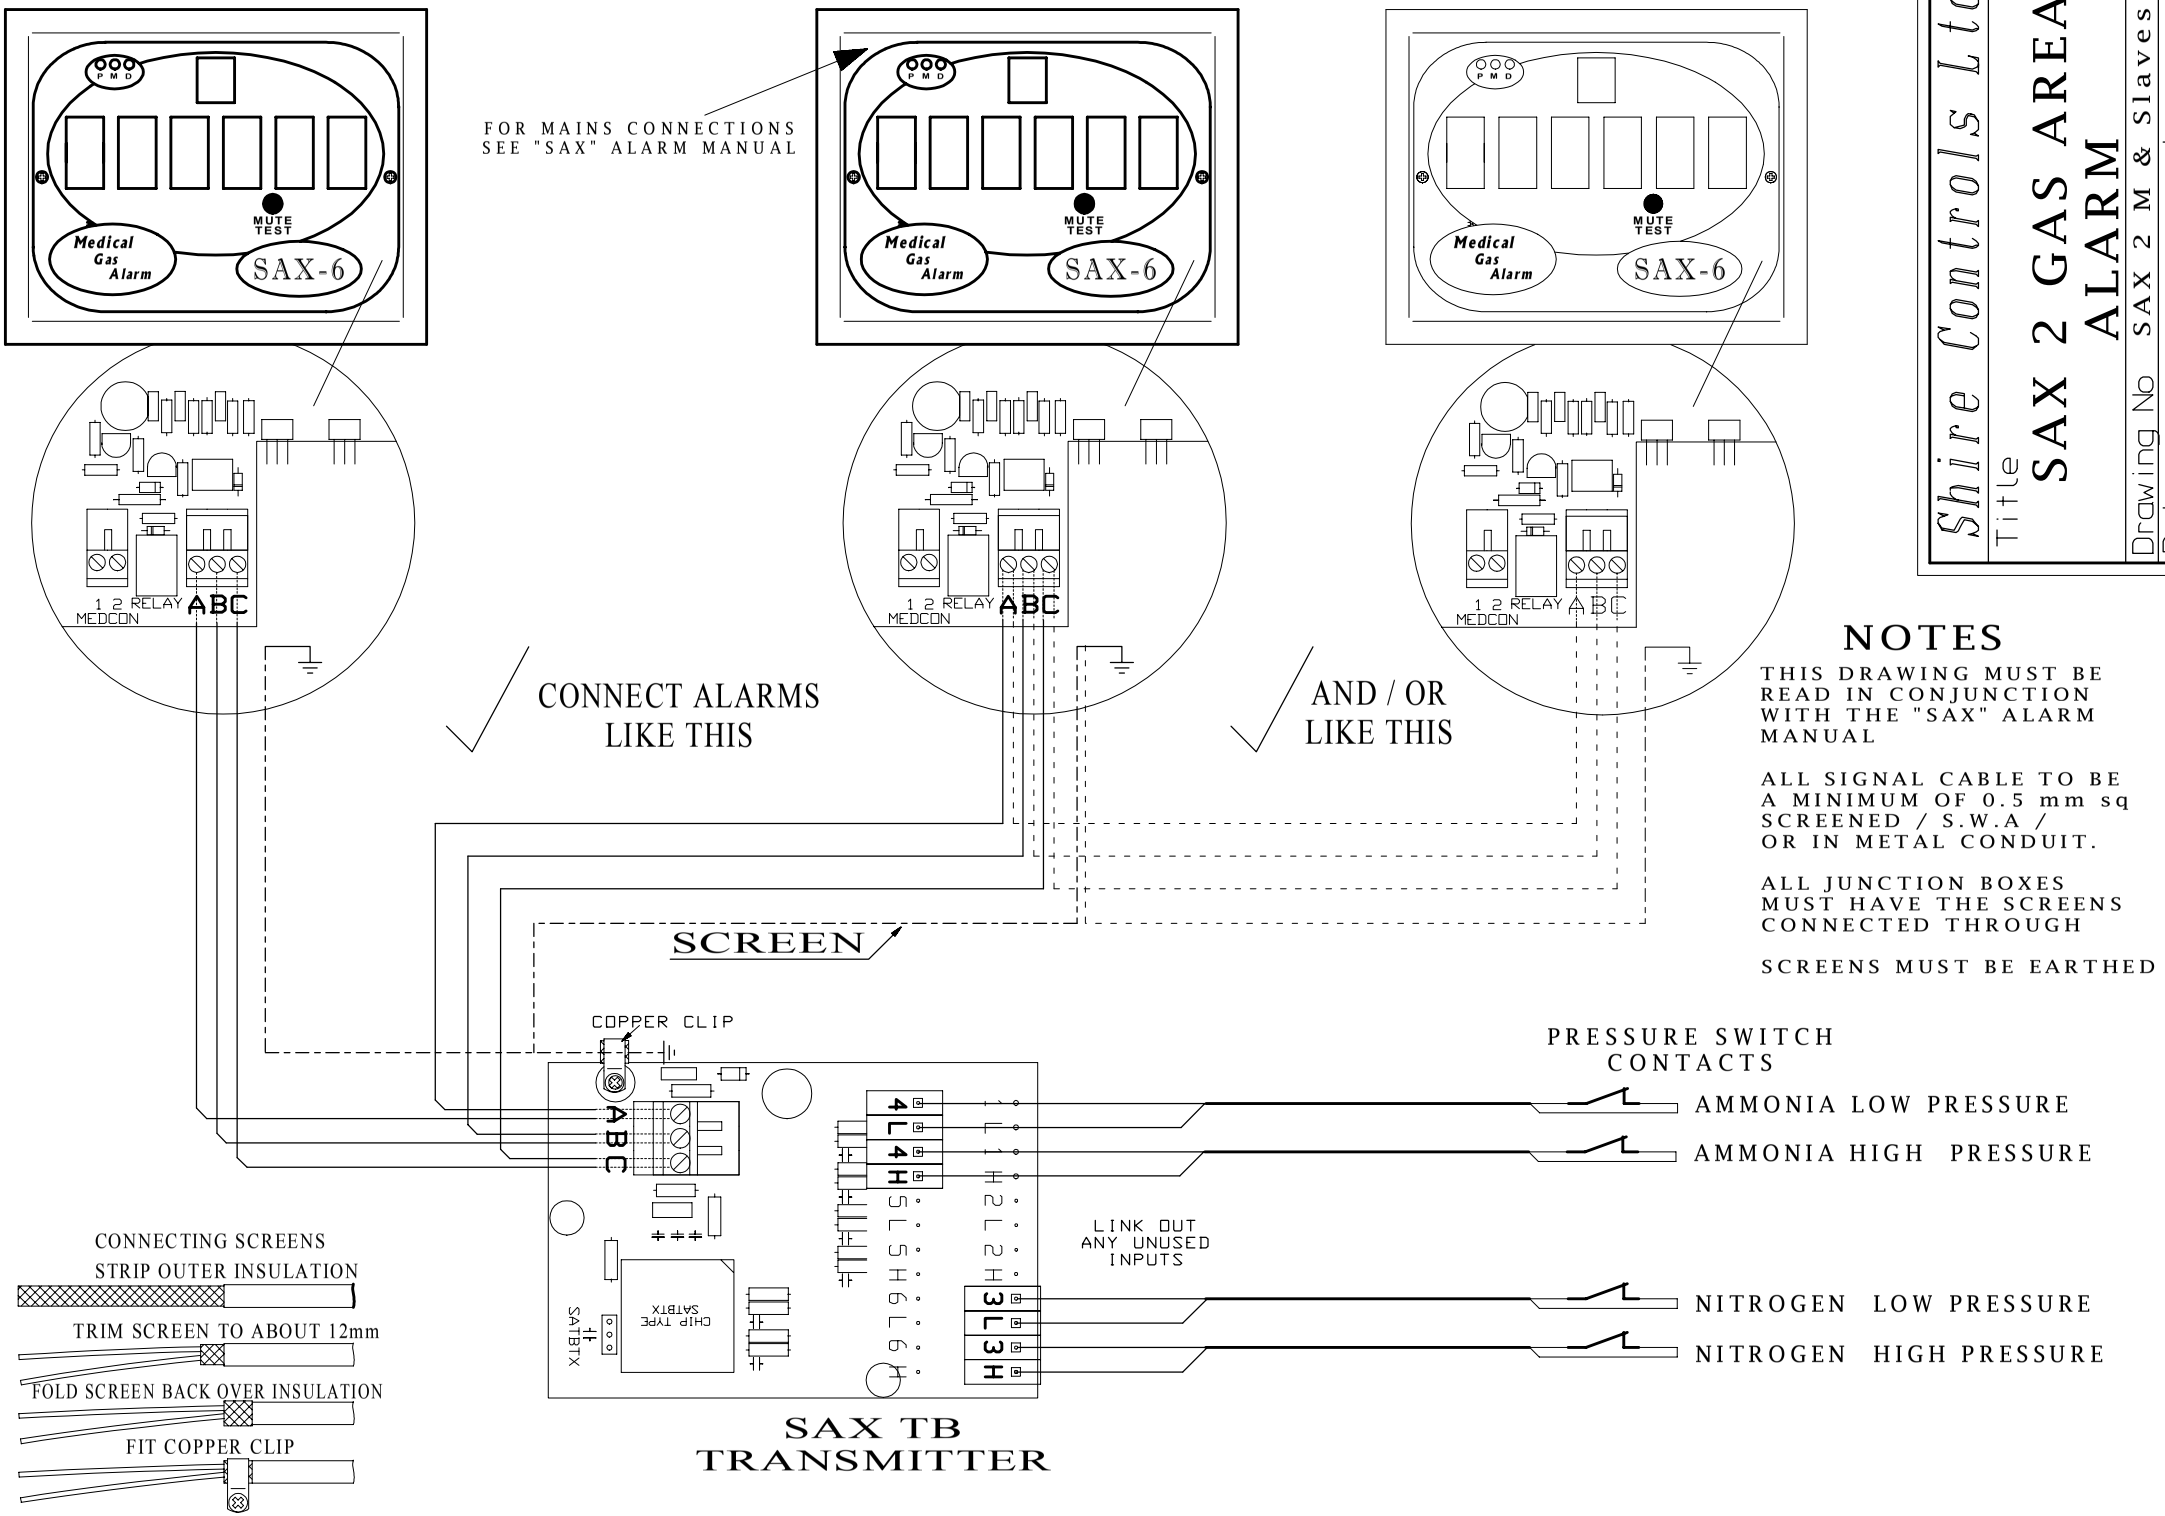
Shire Controls Ltd
Title
SAX 2 GAS AREA ALARM
Drawing No SAX 2 M & Slaves
Date 04-03-2002
Issue 1
FOR MAINS CONNECTIONS SEE "SAX" ALARM MANUAL
Medical Gas Alarm
SAX-6
MUTE TEST
1 2 RELAY
MEDCON
ABC
CONNECT ALARMS LIKE THIS
AND / OR LIKE THIS
SCREEN
COPPER CLIP
NOTES
THIS DRAWING MUST BE READ IN CONJUNCTION WITH THE "SAX" ALARM MANUAL
ALL SIGNAL CABLE TO BE A MINIMUM OF 0.5 mm sq SCREENED / S.W.A / OR IN METAL CONDUIT.
ALL JUNCTION BOXES MUST HAVE THE SCREENS CONNECTED THROUGH
SCREENS MUST BE EARTHED
PRESSURE SWITCH CONTACTS
AMMONIA LOW PRESSURE
AMMONIA HIGH PRESSURE
NITROGEN LOW PRESSURE
NITROGEN HIGH PRESSURE
LINK OUT ANY UNUSED INPUTS
CONNECTING SCREENS
STRIP OUTER INSULATION
TRIM SCREEN TO ABOUT 12mm
FOLD SCREEN BACK OVER INSULATION
FIT COPPER CLIP
SAX TB TRANSMITTER